

US Petroleum #ST329  
2664 Route 122  
Medford, NY 11763

**Photo 1 – General site picture**



**Photo 2 – Layout of three 25,000-gallon USTs**

*Note: Could not remove sump lids because lids required a special tool which was not available on site.*




US Petroleum #ST329  
2664 Route 122  
Medford, NY 11763

**Photo 3 – Layout of two 10,000-gallon USTs**

*Note: Could not remove sump lids because lids required a special tool which was not available on site.*




**Photo 4 – Fill port for 10,000-gallon diesel tank with flapper valve visible**

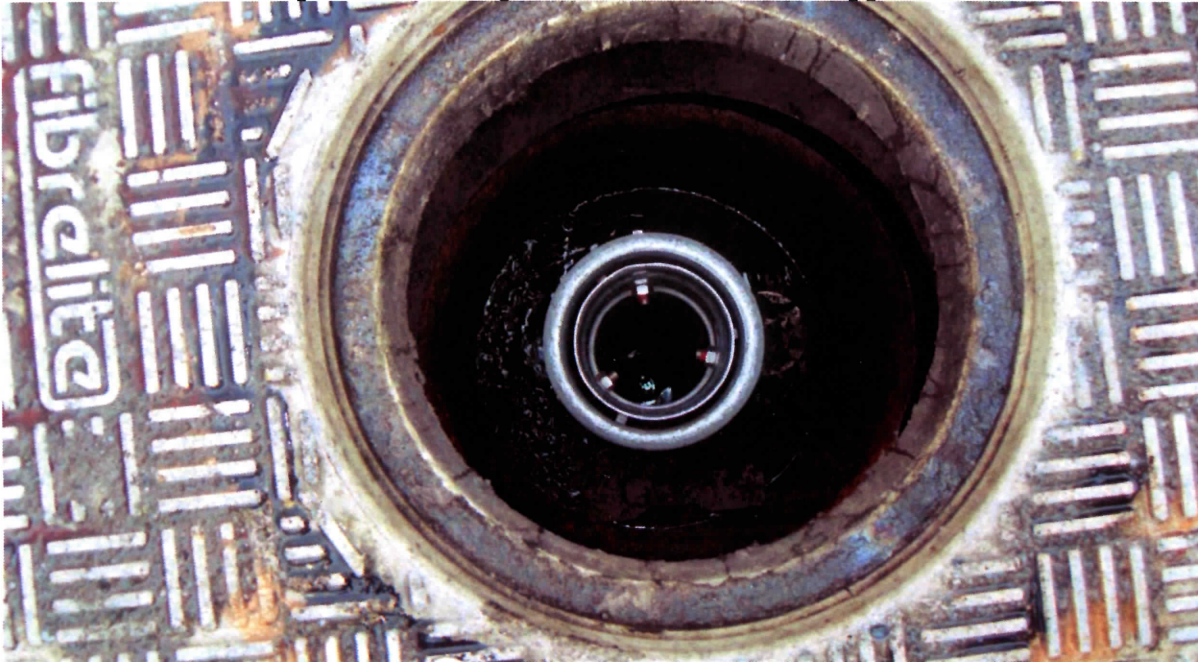

US Petroleum #ST329  
2664 Route 122  
Medford, NY 11763

**Photo 5 - Fill port for 10,000-gallon gasoline tank (flapper valve in drop tube)**

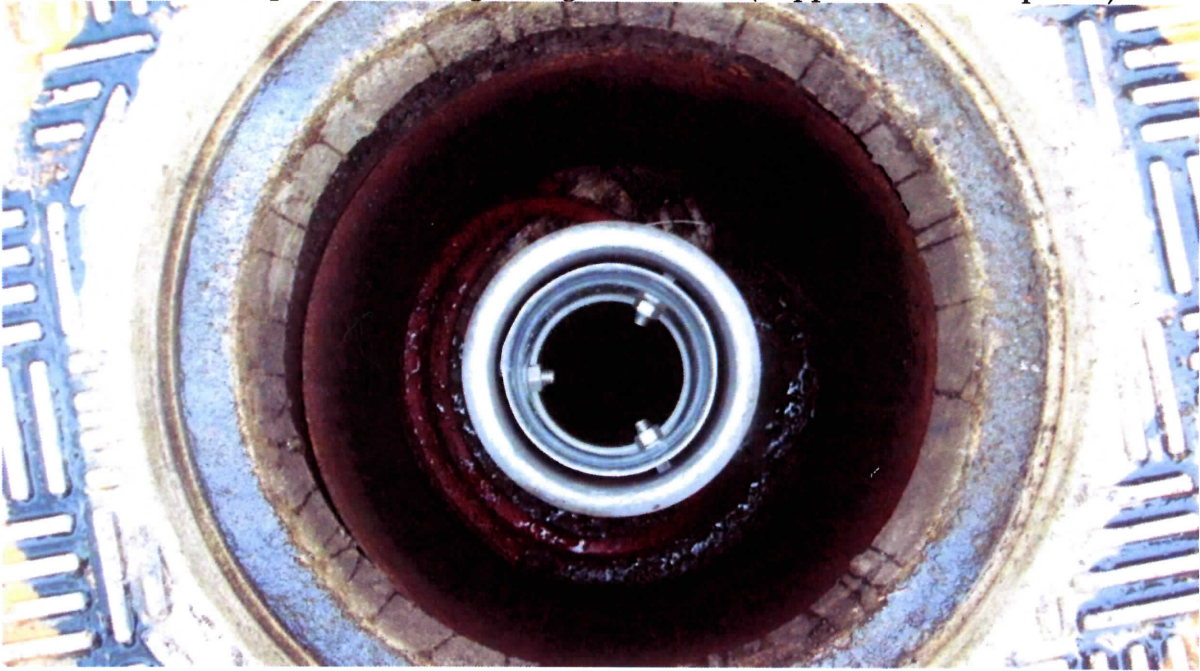


**Photo 6 - Fill port for 25,000-gallon gasoline tank**



US Petroleum #ST329  
2664 Route 122  
Medford, NY 11763

**Photo 7 - Fill port for 25,000-gallon diesel tank**

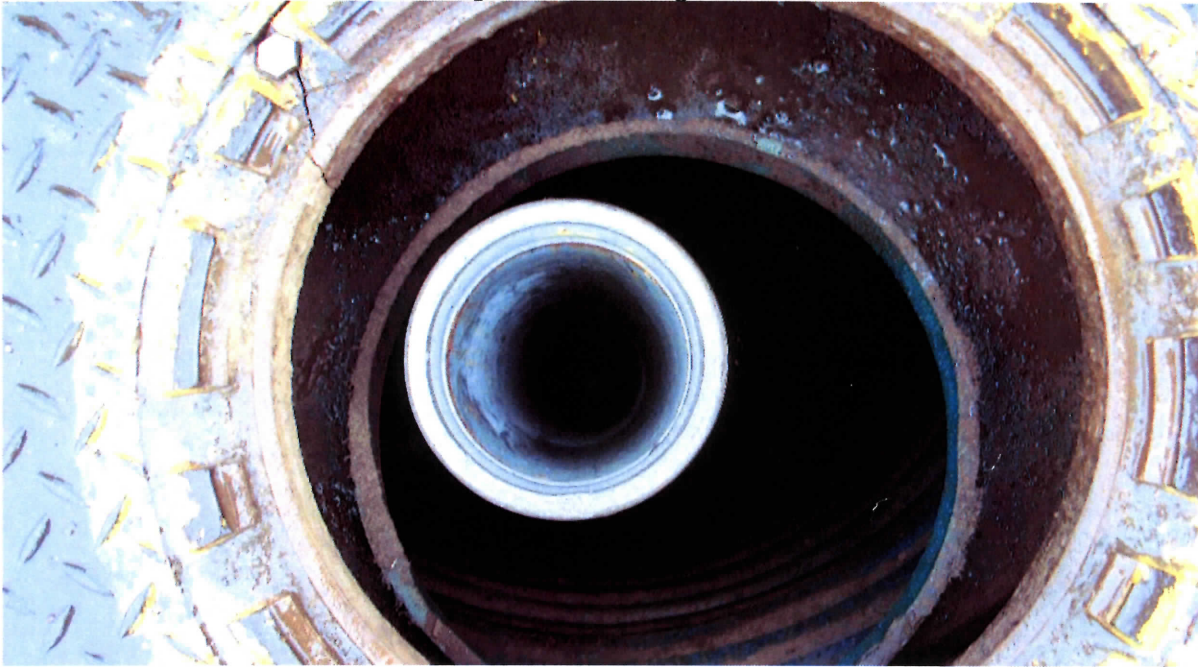

**Photo 8 - Audible/visual overfill alarm for three 25,000-gallon USTs (10,000-gallon USTs are equipped with flapper valve in drop tubes)**

